

# Pebble Beach Community Services District





## LONG-TERM CAPITAL OUTLAY PLAN

**MARCH 2026**

# COST SUMMARY BY DEPARTMENT

## 2026 LONG-TERM CAPITAL OUTLAY PROGRAM

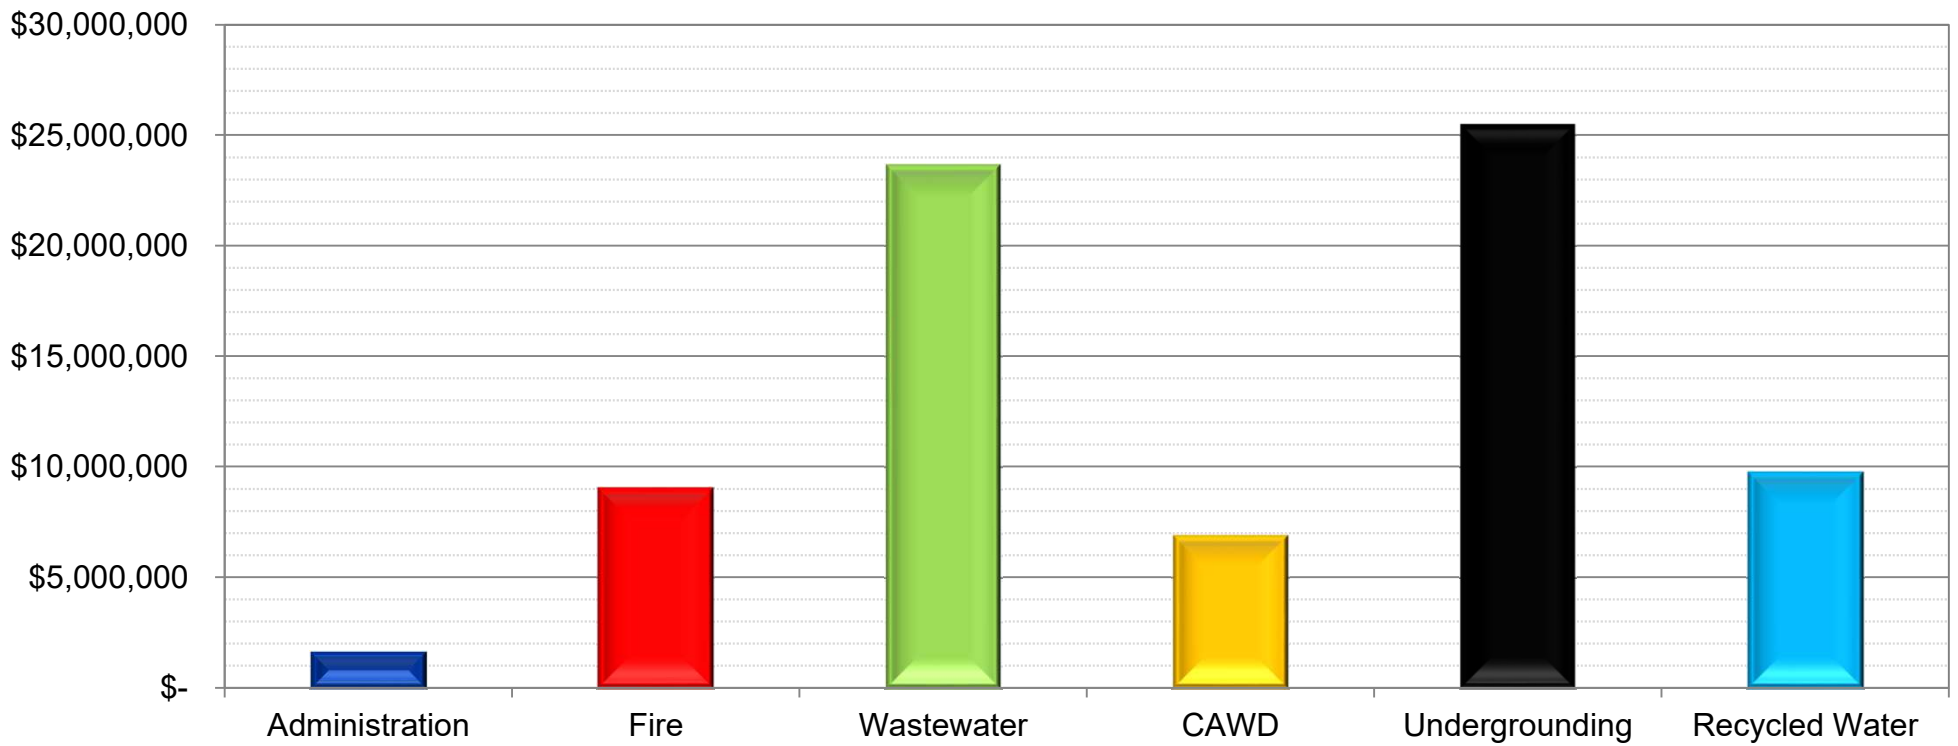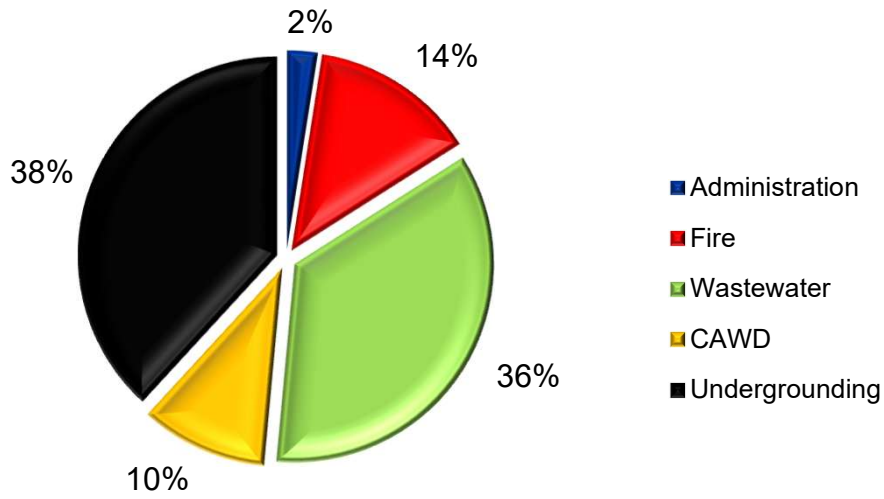

**15yr SUMMARY**  
**2026 LONG-TERM CAPITAL OUTLAY PROGRAM**

FISCAL YEAR	Exhibit A Administration	Exhibit B Fire	Exhibit C Wastewater	Exhibit D CAWD	Exhibit E Undergrounding	FISCAL YEAR TOTAL	Exhibit F Recycled Water
2026/27	\$ 50,000	\$ 230,000	\$ 2,840,000	\$ 649,000	\$ 3,000,000	\$ 6,769,000	\$ 115,000
2027/28	\$ 465,000	\$ 1,802,000	\$ 2,810,000	\$ 896,000	\$ 3,000,000	\$ 8,973,000	\$ 355,000
2028/29	\$ 25,000	\$ 247,000	\$ 1,385,000	\$ 1,174,000	\$ 500,000	\$ 3,331,000	\$ 440,000
2029/30	\$ 30,000	\$ 295,000	\$ 1,170,000	\$ 1,543,000	\$ 6,000,000	\$ 9,038,000	\$ 495,000
2030/31	\$ -	\$ 155,000	\$ 1,770,000	\$ 572,000	\$ 3,000,000	\$ 5,497,000	\$ 100,000
2031/32	\$ 240,000	\$ 652,000	\$ 1,230,000	\$ 207,000	\$ 1,000,000	\$ 3,329,000	\$ 200,000
2032/33	\$ -	\$ 757,000	\$ 1,260,000	\$ 207,000	\$ 1,000,000	\$ 3,224,000	\$ 245,000
2033/34	\$ 60,000	\$ 265,000	\$ 1,455,000	\$ 207,000	\$ 1,000,000	\$ 2,987,000	\$ 60,000
2034/35	\$ 95,000	\$ 2,487,000	\$ 1,505,000	\$ 207,000	\$ 1,000,000	\$ 5,294,000	\$ 1,515,000
2035/36	\$ 90,000	\$ 135,000	\$ 1,505,000	\$ 207,000	\$ 1,000,000	\$ 2,937,000	\$ 315,000
2036/37	\$ 30,000	\$ 235,000	\$ 1,110,000	\$ 207,000	\$ 1,000,000	\$ 2,582,000	\$ 5,120,000
2037/38	\$ 295,000	\$ 267,000	\$ 1,355,000	\$ 207,000	\$ 1,000,000	\$ 3,124,000	\$ 80,000
2038/39	\$ 70,000	\$ 145,000	\$ 1,620,000	\$ 207,000	\$ 1,000,000	\$ 3,042,000	\$ 340,000
2039/40	\$ 170,000	\$ 305,000	\$ 1,175,000	\$ 207,000	\$ 1,000,000	\$ 2,857,000	\$ 315,000
2040/41	\$ 25,000	\$ 1,052,000	\$ 1,495,000	\$ 207,000	\$ 1,000,000	\$ 3,779,000	\$ 75,000
<b>DEPT TOTAL</b>	<b>\$ 1,645,000</b>	<b>\$ 9,029,000</b>	<b>\$ 23,685,000</b>	<b>\$ 6,904,000</b>	<b>\$ 25,500,000</b>	<b>\$ 66,763,000</b>	<b>\$ 9,770,000</b>

2025 TOTAL      \$ 1,545,000      \$ 8,577,000      \$ 26,556,000      \$ 5,596,000      \$ 52,000,000      \$ 94,613,000      \$ 9,985,000

DIFFERENCE      6.5%      5.3%      -10.8%      23.4%      -51.0%      -29.4%      -2.2%

**EXHIBIT A**  
**Administration Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)															
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41	
COMPUTERS & COMM.	1	Parking Lot Pavement	15 years	\$200															
	2	Furnaces (4)	10 years		\$25												\$25		
	3	Board Room Furniture	12 years														\$30		
	4	Board Room Sound System/Microphones (replaced in 2021)	10 years							\$20									
	5	Paint Building Exterior (Admin. & Fire)	10 years										\$70						
	6	Fire Alarm System Replacement	10 years		\$20												\$20		
	7	Carpeting	12 years														\$70		
	8	Training Room Furniture	12 years														\$30		
	9	Admin Office Furniture	12 years														\$90		
	10	Replace Building Generator (80kW_Replaced in 2019)	20 years																\$50
	11	Roof Replacement (Admin. & Fire)	30 years		\$50	\$300													
COMPUTERS & COMM.	12	Network Servers (2): File/Email Server Document Management Server	4 years				\$30					\$30				\$30			
	13	Network Servers (2): InfoSys/GIS Server Backup/Security Server	4 years		\$30				\$30				\$30				\$30		
	14	Workstation/Laptop Computers (12) + Install	4 years		\$60				\$60					\$60				\$60	
	15	Records Management Software	5 years	\$30					\$30						\$30				
	16	Telephone & Voicemail System (Replaced 2021)	10 years							\$30									
MISC.	17	Board Room Presentation System	7 years							\$35							\$35		
	18	Training Room Presentation System	7 years							\$35							\$35		
	19	Network Combination Copier/Printer/Scanner	6 years			\$25							\$25					\$25	
	20	Traffic Monitoring Radar Units (4) (Replaced in 2021-22)	6 years		\$30							\$30						\$30	
TOTAL FISCAL YEAR COST (1,000)				\$50	\$465	\$25	\$30	\$0	\$240	\$0	\$60	\$95	\$90	\$30	\$295	\$70	\$170	\$25	

**ADMINISTRATION DEPARTMENT TOTAL: \$1,645,000**

**EXHIBIT A**  
**Administration Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
1	<b><u>Parking Lot Pavement</u></b> Front office paving every 15 years.
2	<b><u>Furnaces (4)</u></b> Replace the four furnaces (Front Office/Board Room/Training Room/Back Offices & DMFC/DMFPO) that serve the administration offices every ten years. Large AC unit commissioned in 2026 as part of office remodel. 3 furnace units still in need of replacement.
3	<b><u>Board Room Furniture</u></b> Replace the Board Room desks and tables every twelve years.
4	<b><u>Board Room Sound System/Microphones</u></b> Replace the sound system and microphones in the Board Room every ten years.
5	<b><u>Paint Administration Building Exterior (Admin. &amp; Fire)</u></b> Paint exterior of administration & fire buildings every ten years.
6	<b><u>Fire Alarm System Replacement</u></b> The fire alarm system for the District Offices will be replaced every ten years.
7	<b><u>Carpeting</u></b> Replace the carpeting in the administration offices every twelve years. Last replaced in March 2026 as part of Facilities Improvement Project.
8	<b><u>Training Room Furniture</u></b> Replace the Training Room tables every twelve years.
9	<b><u>Admin Office Furniture</u></b> Replace the ergonomic workstation furniture in admin offices (staff and management) every twelve years
10	<b><u>Replace Building Generator</u></b> Replace the 80 KW generator that provides emergency back-up power to the administration building complex every twenty years. The generator is fueled by natural gas and includes a back-up propane system. Last replaced 2019.
11	<b><u>Roof Replacement (Admin. &amp; Fire)</u></b> Replace the administration and fire building roof every thirty years. Admin and Fire shared roof is approximately 15,000 sf.
12	<b><u>Network Servers (2): File/Email Server &amp; Document Management Server</u></b> Replace the File/Email Server & Document Management Server that serve the administration, fire and maintenance departments, which are planned to be upgraded every four years.
13	<b><u>Network Servers (2): InfoSys/GIS Server &amp; Backup/Security Server</u></b> Replace the InfoSys/GIS Server and the dedicated Backup/Security Server that serve the administration, fire and maintenance departments, which are planned to be upgraded every four years.
14	<b><u>Workstation/Laptop Computers</u></b> Replace and upgrade administration computer/laptop workstations every four years.

**EXHIBIT A**  
**Administration Department Capital Outlay Plan**

<b>ITEM NO.</b>	<b>CAPITAL ITEM</b>
<b>15</b>	<b><u>Records Management Software</u></b> Update of the records management software from Questys Laserfiche. Cost includes setup, configuration, consulting, training, records management and retention.
<b>16</b>	<b><u>Telephone &amp; Voicemail System</u></b> Upgrade/replace telephone and voicemail system every ten years.
<b>17</b>	<b><u>Board Room Presentation System</u></b> Replace the Presentation System in the Board Room every six years, including video digital display unit, controllers and presentation console. The presentation console includes a computer and other equipment to connect to the District network.
<b>18</b>	<b><u>Training Room Presentation System</u></b> Replace the Presentation System in the Training Room every six years, including video digital display unit, controllers and presentation console. The presentation console includes a computer and other equipment to connect to the District network.
<b>19</b>	<b><u>Network Combination Copier/Printer/Scanner</u></b> Replace the primary network combination color copier/printer/scanner every six years. The replaced unit will serve as backup to the new unit.
<b>20</b>	<b><u>Traffic Monitoring Radar Units (4)</u></b> Replace four traffic monitoring radar units every six years.

**EXHIBIT B**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)														
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41
PEBBLE BEACH FACILITIES	1	PPE Dryers**	5 years			\$15					\$15				\$15			
	2	Kitchen & Living Room Furniture	7 years				\$5						\$5					
	3	Media Center and Electronic Components	7 years			\$5							\$5					
	4	Dormitory Furniture	7 years	\$10							\$10							\$10
	5	Physical Fitness Equipment	8 years				\$10									\$10		
	6	Universal Weight Machine	10 years							\$7								
	7	Furnace	10 years									\$15						
	8	Carpet (Replaced in 2021)	10 years							\$20								
	9	Ergonomic Office Furniture (Replaced 2021)	10 years							\$50								
	10	Window Replacement/Coverings	10 years				\$10											\$10
	CARMEL HILL FACILITIES	11	Vehicle Exhaust Removal System	10 years									\$75					
12		Overhead Electric Door/Motors (8) (Replaced 2022)	15 years												\$75			
13		PPE Lockers	20 years												\$10			
14		Gym Athletic Rubber Flooring	20 years		\$15													
15		Carmel Hill Physical Fitness Equipment**	8 years									\$5						
16		Carmel Hill Carpet**	10 years				\$10										\$10	
18		Pump St. @ Carmel Hill Fire Station** (Rehabbed 2018-19)	Rehab.															
19		Instrumentation** (Mission Unit)	5 years			\$5						\$5					\$5	
20		Pump Replacement**	10 years			\$10											\$10	
21		Valves & Appurtenances**	15 years									\$5						
22		Control Panel**	15 years									\$10						
COMPUTERS & COMM.	24	Command Staff Computers (9)**	4 years	\$10			\$10				\$10				\$10			
	25	Workstation Computers (8)	4 years			\$25					\$25			\$25			\$25	
	26	ipad Tablets Computers (16)**	3 years		\$20			\$20				\$20			\$20		\$20	
	27	AVL Server & Equipment Replacement*** (Purchased 2021-2022)	5 years		\$70						\$70				\$70			
	28	Network Combination Copier/Printer/Scanner	6 years			\$12						\$12					\$12	
	29	Portable Radios (25)	10 years		\$55										\$55			
	30	Radio Repeater Equipment	10 years		\$5										\$5			
	31	Base Radio	10 years										\$70					
EQUIPMENT	32	Carmel Hill Base Radio**	10 years										\$35					
	33	Carmel Hill Equipment**	Annual		\$10	\$10	\$10	\$10	\$10	\$10	\$10	\$10	\$10	\$10	\$10	\$10	\$10	
	34	AED Defibrillators (2)	5 years						\$10				\$10				\$10	
	35	Battalion Training Program Equipment**	5 years			\$10						\$10				\$10		
	36	Thermal Imaging Cameras (5)**	5 years				\$40					\$40				\$40		
	37	Paramedic EKG Monitors (4)**	5 years				\$200					\$200				\$200		

**EXHIBIT B**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)															
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41	
<b>EQUIPMENT</b>	38	ALS Manikin** (Purchased in 2021-2022)	5 years		\$40					\$40					\$40				
	39	Prevention Public Ed Fire Extinguisher Prop	5 years						\$5					\$5					\$5
	40	Battalion Training Program Flatbed Trailer*** (Purchased 2021-2022)	15 years												\$15				
	41	SCBA Units & Spare Tanks (27)**	15 years								\$200								
	42	Air Compressor, Rack, and Fill Station (2)**	15 years			\$100													
<b>RESCUE EQUIPMENT</b>	43	Water Rescue Program Equipment	5 years				\$5						\$5					\$5	
	44	Water Rescue Craft**	5 years		\$7						\$7					\$7			
	45	Inflatable Rescue Boat (IRB)**	10 Years							\$20									
	46	Swift Water Rescue Boat (SWRB)**	10 Years							\$5									
	47	High-Pressure Rescue Airbag Kit (2)**	10 years		\$15										\$15				
	48	Rope Rescue Gear Ropes**	10 years								\$5								
	49	Hydraulic Rescue Tools (Ladder Truck 22)	10 years										\$50						
	50	Hydraulic Rescue Tools (Medic Engine 22)	10 years				\$20										\$20		
	51	Hydraulic Rescue Tools (Medic Engine 28) **	10 years				\$20										\$20		
	52	Confined Space Rescue Equipment	10 years				\$20										\$20		
	53	Drones - Fire Prevention**	2 years		\$50		\$50		\$50		\$50		\$50		\$50		\$50		\$50
<b>VEHICLES</b>	54	4WD Command Vehicle 4601** (2019); PBCSD	8 years		\$55								\$55						
	55	4WD Command Vehicle B21** (2023); Cypress	8 years								\$60							\$60	
	56	4WD Command Vehicle B22** (2023); Cypress	8 years								\$60							\$60	
	57	4WD Command Vehicle B25** (2019); PBCSD	8 years		\$60								\$60						
	58	Paramedic Vehicle B26** (2023); PBCSD	8 years								\$60							\$60	
	59	Fire Protection and Planning Vehicle P24** (2021); Highlands	8 years				\$60								\$60				
	60	Fire Protection and Planning Vehicle P25** (2024); Cypress	8 years								\$50							\$50	
	61	Fire Protection and Planning Vehicle P26** (2016); PBCSD	8 years	\$20								\$50							
	62	Fire Protection and Planning Vehicle P27** (2017); PBCSD	8 years	\$20								\$50							
	63	Fire Protection and Planning Vehicle P28** (2024); Highlands	8 years								\$50							\$50	
	64	Battalion Training Officer Vehicle T51** (2024); PBCSD	8 years								\$50							\$50	
	65	Station Utility Truck U22** (2021); Cypress	10 years						\$60									\$60	
	66	Polaris All-Terrain Vehicle	10 years								\$35								
67	Ladder Truck 22 (2024); PBCSD	10 years										\$2,000							
68	Medic Engine 28** (Carmel Hill) (2022); Cypress	10 years							\$500										
69	Medic Engine 22 (2011); PBCSD	15 years			\$1,500														
70	Wildland Patrol Vehicle 22 (2025)	15 years																\$550	
<b>TOTAL FISCAL YEAR COST (1,000)</b>					\$230	\$1,802	\$247	\$295	\$155	\$652	\$757	\$265	\$2,487	\$135	\$235	\$267	\$145	\$305	\$1,052

**FIRE DEPARTMENT TOTAL: \$9,029,000**

\*\*Items are cost-shared with other fire districts

**EXHIBIT B**  
**Fire Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
1	<b><u>PPE Dryers**</u></b> Replace dryers needed to dry personal protective equipment every five years.
2	<b><u>Kitchen &amp; Living Room Furniture</u></b> Replace kitchen table and chairs, and seating furniture for upstairs and downstairs living areas.
3	<b><u>Media Center and Electronic Components</u></b> Replace televisions, dvd players and storage center in upstairs and downstairs living areas.
4	<b><u>Dormitory Furniture</u></b> Replace dormitory furniture, including mattresses, beds, and nightstands (12).
5	<b><u>Carmel Hill Station Physical Fitness Equipment**</u></b> Replace physical fitness exercise equipment for the Carmel Hill fire station every eight years at a 50% cost-share with Cypress District.
6	<b><u>Physical Fitness Equipment</u></b> Replace two commercial-grade treadmill and an elliptical machine in gym every eight years.
7	<b><u>Universal Weight Machine</u></b> Replace the universal weight machine used in the gym every ten years.
8	<b><u>Furnace</u></b> Replace the furnace every ten years.
9	<b><u>Carpet</u></b> Replace the carpeting in the fire department every ten years.
10	<b><u>Carmel Hill Carpet**</u></b> Replace the carpeting in the fire department every ten years. PBCSD at 50% cost share.
11	<b><u>Ergonomic Office Furniture</u></b> Replace ergonomically designed workstation furniture in the Fire Department offices every ten years.
12	<b><u>Window Replacement/Coverings</u></b> Replace the windows/coverings in the fire department every twelve years.
13	<b><u>Vehicle Exhaust Removal System</u></b> Exhaust removal systems are installed in each apparatus bay and are to be replaced every ten years.
14	<b><u>Overhead Electric Doors/Motors (8)</u></b> Electric Motors/Doors/Tracks will be installed on 8 metal overhead doors on for Fire Department parking bays.
15	<b><u>Carmel Hill Pavement Restoration**</u></b> Capital Improvement Project cost share 50/50 between Cypress & Pebble Restoration of driveway/parking lot asphalt every fifteen years. PBCSD at 50% cost share.
16	<b><u>PPE Lockers</u></b> Replacement of existing lockers.

**EXHIBIT B**  
**Fire Department Capital Outlay Plan**

**ITEM  
NO.**

**CAPITAL ITEM**

- 17 Gym Athletic Rubber Flooring**  
Replace athletic rubber flooring in the Fire Department gym.
- 21 Sewer Pump Station @ Carmel Hill Fire Station\*\***  
Rehabilitate sewer pump station at Carmel Hill Fire Station.
- 22 Instrumentation\*\***  
Replace Sewer Pump Station Instrumentation every five years.
- 23 Pump Replacement\*\***  
Replace Sewer Pump Station Pumps every ten years.
- 24 Valves & Appurtanances\*\***  
Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
- 25 Control Panel\*\***  
Replace Sewer Pump Station Control Panel every fifteen years.
- 26 Force-Main\*\***  
Replace Sewer Pump Station Force-Main every twenty five years.
- 27 Command Staff Computers (9)\*\***  
Replace nine cost-shared computer used by fire command positions every four years. Each workstation will include a computer, monitor, keyboard and printer.
- 28 Workstation Computers (5)**  
Replace five computer workstations used by the operations and prevention staff every four years. Each workstation will include a computer, monitor, keyboard and printer.  
100% PBCSD
- 29 Mobile Data Computers (16)\*\***  
Replace sixteen ipad tablet computers every four years. PBCSD is responsible for 5 at 100%, 1 at 50%, and 10 at 37.5%.
- 30 AVL Server and Equipment**  
Replace server and equipment required for AVL system every 5 years. 6-way cost share (PBCSD Share = 29.15%)
- 31 Network Combination Copier/Printer/Scanner (ADD AVL Server & Remote)**  
Replace the fire department network combination copier/printer/scanner every six years.
- 32 Portable Radios (25)**  
District's current portable radios were purchased as part of a County wide grant. Radios have out lived their operational/useful life.
- 33 Radio Repeater Equipment**  
Replace radio repeater equipment every ten years.
- 34 Base Radio**  
Replace the base radio station located at fire operations offices every ten years.
- 35 Carmel Hill Station Equipment\*\***  
The Carmel Hill Fire Station is operated jointly with Cal Fire and the Cypress Fire Protection District. An annual allocation of \$10,000 per year is included for the PBCSD's share (50%) of replacing capital equipment.

**EXHIBIT B**  
**Fire Department Capital Outlay Plan**

**ITEM  
NO.**

**CAPITAL ITEM**

**36 AED Defibrillators (2)**

Replace two semi-automatic defibrillators used on first response emergency calls every five years.

**37 Battalion Training Program Equipment\*\***

Replace the cost-shared SCBA Fit Tester, Forcible Entry Prop, and Fire Extinguisher Simulator used in the Battalion Training Program every five years. PBCSD is responsible for 37.5%.

**38 Thermal Imaging Cameras (5)\*\***

Replace five thermal imaging cameras every five years. The camera can detect dangerous, unseen obstacles and assist in rescue operations during low-visibility conditions. 1 camera is located on the medic engine, 1 on the reserve engine, 1 on the ladder truck, 1 on the reserve ladder truck, and 1 on the Carmel Hill medic engine at 50% cost-share.

**39 Paramedic EKG Monitors (4)\*\***

Replace four 12-lead monitor EKGs used by paramedics to monitor heart rhythms every five years. 1 monitor will be located on Medic Engine 22, 1 on Medic Truck 22, 1 on the Carmel Hill medic engine at 50% cost-share, and 1 on the paramedic vehicle at 37.5% cost-share.

**40 Active Shooter PPE**

Replace built proof vests every five years.

**41 Prevention Public Ed Fire Extinguisher Prop**

Fire extinguisher prop replaced every five years

**42 Battalion Training Program Flat Bed Trailer\*\***

Replace BTP Flat Bed Trailer every 15 years. PBCSD Cost Share 37.5%

**43 SCBA Units & Spare Tanks (27)\*\***

Replace twenty Self-Contained Breathing Apparatuses (SCBA) every fifteen years. Units include a pack, an air cylinder rated for 45 minutes of use, a full-face air mask, mic, and related valves and hoses. 5 SCBAs are located in the medic engine, 5 in the reserve engine, 5 in the ladder truck, and 5 in staff vehicles (2 for prevention and 3 at 37.5% cost-share) & purchase twenty-seven spare tanks for Self-Contained Breathing Apparatus units.

**44 Air Compressor, Rack, and Fill Station (2)\*\***

Replace the air compressor used to fill air bottles, rack to store air bottles, and the fill station every fifteen years. One unit is located at PBCSD and one at Carmel Hill Station at 50% cost-share.

**45 Water Rescue Program Equipment**

Replace fire department water rescue equipment (paddle boards, wetsuits, life vest) every five years.

**46 Water Rescue Craft Floating Dock\*\***

Water Rescue Craft Floating Dock installed at Stillwater Pier, to be replaced every five years. PBCSD Cost Chare 33.5%

**47 Water Rescue Craft\*\***

Water Rescue Craft to be replaced every seven years. Cost Share 33%.

**48 Inflatable Rescue Boat (IRB)\*\***

Motor driven inflatable boat used for ocean rescue, repalced every ten years. Cost Share 33%

**EXHIBIT B**  
**Fire Department Capital Outlay Plan**

**ITEM  
NO.**

**CAPITAL ITEM**

**49 Swift Water Rescue Boat (SWRB)\*\***

Inflatable rescue boat used for swift water rescue, replaced every ten years. Cost Share 33%

**50 High-Pressure Rescue Airbag Kit (2)\*\***

Replace two airbag kits containing items required to lift heavy objects during rescue operations every ten years, 1 at a 50% cost-share with Cypress District.

**51 Rope Rescue Gear Ropes\*\***

Rope rescue gear on Truck 22, Medic Engine 22, and Medic Engine 28 (PBCSD Cost Share = 50%), replace every ten years.

**52 Hydraulic Rescue Tools on Ladder Truck 22**

Replace hydraulic rescue tool set on Ladder Truck 22 used to provide access to damaged vehicles every ten years.

**53 Hydraulic Rescue Tools on Medic Engine 22**

Replace hydraulic rescue tool (jaws of life) on Medic Engine 22 used to provide access to damaged vehicles every ten years.

**54 Hydraulic Rescue Tools on Medic Engine 28\*\***

Replace hydraulic rescue tool set on Medic Engine 28 used to provide access to damaged vehicles every ten years. Cost Share 50%.

**55 Confined Space Rescue Equipment**

Purchase equipment to perform a confined-space emergency rescue. Including tripod, winch, rescue lines, portable ventilation units and rescue baskets used for permit required confined space entry and rescue.

**56 Drones**

Drones and equipment to be replaced every ten years. Assume full cost (no cost share) for 21/22, and cost share of 37.5% for future.

**56 4WD Command Vehicle 4601\*\***

Replace four-wheel drive utility vehicle 4601 used by the fire division chief, including lights, radio console and command box every eight years at 37.5% cost-share.

**57 4WD Command Vehicle B21\*\***

Replace four-wheel drive utility vehicle B21 used by the fire protection and planning chief including lights, radio console and command box every eight years at 37.5% cost-share.

**58 4WD Command Vehicle B22\*\***

Replace four-wheel drive utility vehicle B22 used by the fire protection and planning chief including lights, radio console and command box every eight years at 37.5% cost-share.

**59 4WD Command Vehicles B25\*\***

Replace four-wheel drive utility vehicle B25 used by the fire protection and planning chief including lights, radio console and command box every eight years at 37.5% cost-share.

**60 Paramedic Vehicle B26\*\***

Replace the cost-shared pickup truck used by the EMS Captain, including lights, radio console and command box every eight years. The vehicle is cost-shared with Cypress & Carmel Highlands Fire Protection Districts. PBCSD Cost Share = 37.5%.

**61 Fire Protection and Planning Vehicle P24\*\***

Replace utility pickup truck 4624 used by the fire protection and planning captain including lights, radio console and command box every eight years. The cost reported for this vehicle represents PBCSD's 37.5% share.

**EXHIBIT B**  
**Fire Department Capital Outlay Plan**

**ITEM  
NO.**

**CAPITAL ITEM**

**62 Fire Protection and Planning Vehicle P25\*\***

Replace utility pickup truck 4625 used by the fire protection and planning captain including lights, radio console and command box every eight years. The cost reported for this vehicle represents PBCSD's 37.5% share.

**63 Fire Protection and Planning Vehicle P26\*\***

Replace small utility pickup truck 4626 used by the fire protection and planning captain including lights, radio console and command box every eight years. The cost reported for this vehicle represents PBCSD's 37.5% share.

**64 Fire Protection and Planning Vehicle P27\*\***

Replace small utility pickup truck 4627 used by the fire protection and planning captain including lights, radio console and command box every eight years. The cost reported for this vehicle represents PBCSD's 37.5% share.

**65 Fire Protection and Planning Vehicle P28\*\***

Replace small utility pickup truck 4628 used by the fire protection and planning captain including lights, radio console and command box every eight years. The cost reported for this vehicle represents PBCSD's 37.5% share.

**66 Battalion Training Officer Vehicle T51\*\***

Replace utility pickup truck used by training officer, which has an expected useful life of eight years. The cost reported for this vehicle represents PBCSD's 37.5% share.

**67 Station Utility Truck U22\*\***

Replace the cost-shared utility pickup truck with ladder rack for use at the Carmel Hill station every ten years at 50%. Replaced in 2021.

**68 Polaris All-Terrain Vehicle\*\***

All-Terrain Vehicle to be replaced every ten years. Cost Share 37.5%.

**70 Polaris All-Terrain Vehicle**

All-Terrain Vehicle to be replaced every ten years. No cost share. To be owned 100% by PBCSD.

**71 Ladder Truck 22**

Replace the quint 70-foot ladder Truck engine 22 with a pumping capacity of 1500 gpm every ten years. Quint refers to the five components of the vehicle including pump, water tank, fire hose, aerial device and ground ladders.

**72 Medic Engine 28\*\* (Carmel Hill)**

Replace the Carmel Hill Station medic engine with a pumping capacity of 1500 gpm every ten years at 50% cost-share.

**73 Medic Engine 22**

Replace the first-line medic engine with a pumping capacity of 1500 gpm every fifteen years. The replaced medic engine will be reassigned as the reserve engine 22, and the replaced reserve engine will become surplus equipment. The expected useful life is twenty years with approximately fifteen years as a first-line engine, and the remaining years as the reserve engine.

**74 Wildland Patrol Vehicle 22**

Replace the Type IV wildland engine 22 every fifteen years. This vehicle is used for patrolling open space areas daily during peak fire conditions and for initial response to incidents in open spaces. It includes a 300-gallon water storage tank and 190 gpm pump.

\*\*Items are cost-shared with other fire districts



**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)															
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41	
PUMP ST. No.04	45	Underground Diesel Storage Tank - TIUGA Conversion	25 years			\$150													
	46	Force Main (Condition Assessment) (installed 2008)	25 years				\$50												
PUMP ST. No.04	47	Pump Station P-4 (HWY 68) Est. 1969	Rehab.	\$860	\$540														
	48	Instrumentation	5 years					\$10						\$10				\$10	
	49	Remote SCADA Hardware and Software	10 years											\$75					
	50	Pump Replacement (25hp_240v)	10 years											\$60					
PUMP ST. No.05	54	Pump Station P-5 (SUNSET LN.) Est. 1969	Rehab.		\$100	\$1,000													
	55	Instrumentation	5 years								\$10						\$10		
	56	Remote SCADA Hardware and Software	10 years														\$75		
	57	Flow Meter	10 years														\$10		
	58	Pump Replacement (25hp_240v)	10 years			\$100											\$100		
	61	Emergency Power Generator (60kW)	15 years			\$150													
	64	Access Road Improvement	One Time																
PUMP ST. No.06	65	Pump Station P-6 (PESCADERO PT.) Est. 2015	Rehab.																
	66	Instrumentation	5 years	\$10						\$10							\$10		
	67	Remote SCADA Hardware and Software	10 years								\$75								
	68	Pump Replacement (7.5hp_240v)	15 years						\$25										
	69	Valves & Appurtenances	15 years						\$15										
	70	Control Panel	15 years						\$150										
PUMP ST. No.07	72	Pump Station P-7 (PBGL 18th) Est. 2012	Rehab.																
	73	Instrumentation	5 years	\$10					\$10					\$10					
	74	Remote SCADA Hardware and Software	10 years							\$75									
	75	Flow Meter	10 years	\$15												\$15			
	76	Wet Well Mixer	10 years									\$20							
	77	Pump Replacement (60hp_480v)	10 years	\$35								\$80							
	78	Valves & Appurtenances	15 years				\$15												
	79	Control Panel	15 years				\$150												
	80	Emergency Power Generator (150kW)	15 years	\$100															
PUMP ST. No.08	83	Pump Station P-8 (SPANISH BAY) Est. 2007	Rehab.																
	84	Instrumentation	5 years		\$10					\$10						\$10			
	85	Remote SCADA Hardware and Software	10 years							\$75									
	86	Wet Well Mixer (Installed 2019)	10 years				\$10										\$10		
	87	Pump Replacement (5hp_480v)	10 years									\$25							
	88	Valves & Appurtenances	15 years			\$15													
	89	Control Panel (Replaced 2021)	15 years											\$150					

**EXHIBIT C  
Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)														
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41
VEHICLES / MOBILE EQUIP.	91 PB-1 Light Utility Truck (General) (2023)	10 years								\$65								
	92 PB-2 Line Cleaning/Vacuum Truck (2021)	10 years						\$450									\$450	
	93 PB-4 Heavy Utility Truck (PS Crew) (2019)	10 years			\$75											\$75		
	94 PB-5 Light Utility Truck (General) (2016)	10 years		\$75										\$75				
	95 PB-8 Line Cleaning Truck (2024)	10 years										\$350						
	96 PB-9 Sewer Line Cleaning Light Utility Vehicle (UTV) (2023)	10 years									\$25							
	97 PB-6 Dump Truck (2023)	15 years													\$100			
	98 Trailer Mounted Sewer Rodder (to be surplused)	15 years																
	99 10" Portable Pump (1999)	15 years														\$150		
	100 6" Portable Pump (2009)	15 years		\$75														
	101 G1 Portable Generator (2004_60kW_120/240v)	15 years														\$75		
	102 G2 Portable Generator (2006_60kW_120/240v) (Rebuilt '23)	15 years														\$75		
	103 G3 Portable Generator (2001_60kW_240/480v) (Rebuilt '20)	15 years														\$75		
	104 G4 Portable Generator (2004_60kW_120/240v)	15 years														\$75		
	105 PB-3 CCTV Camera Van (2006)	20 years	\$150	\$40														
	106 PB-7 Crane Truck (2025)	20 years																
	107 Backhoe Loader (1999)	20 years				\$80												
	108 Easement Line Cleaning Equipment	20 years	\$50															
<b>TOTAL FISCAL YEAR COST (1,000)</b>				<b>\$2,840</b>	<b>\$2,810</b>	<b>\$1,385</b>	<b>\$1,170</b>	<b>\$1,770</b>	<b>\$1,230</b>	<b>\$1,260</b>	<b>\$1,455</b>	<b>\$1,505</b>	<b>\$1,505</b>	<b>\$1,110</b>	<b>\$1,355</b>	<b>\$1,620</b>	<b>\$1,175</b>	<b>\$1,495</b>

**WASTEWATER DEPARTMENT TOTAL \$23,685,000**

\*\*Items are cost-shared with Recycled Water

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

**ITEM  
NO.**

**CAPITAL ITEM**

**1 Fueling Station Rehabilitation**

The fuel pump and monitoring and security system for the diesel and gasoline fueling station will be rehabilitated.

**2 Overhead Electric Door Motors (8)**

Replace eight electric motors on metal overhead doors for Maintenance Building bays.

**3 Paint Exterior Buildings (2)**

Paint exterior of maintenance shop and maintenance vehicle garage buildings every ten years.

**4 Roof Replacement (Maintenance Buildings)**

Replace the roof on the maintenance shop and maintenance vehicle garage every thirty years. Approximately 10,000 sf of roof.

**5 SCADA System Rehabilitation\*\***

Supervisory Control And Data Acquisition (SCADA) System shall be rehabilitated in FY2018/19 and FY2019/20.

**6 SCADA System Servers (3)\*\***

Replace three servers for the SCADA system every five years, servers facilitates communication amongst Wastewater and Reclamation facilities.

**7 SCADA System Software\*\***

Update SCADA System software every five years.

**8 Work Station Computers (4)**

Replace four maintenance computer workstations and two black and white laser printers every five years.

**9 Underground Pipe Locator**

Improved technology will increase the speed and accuracy of locating underground pipes for Underground Service Alert (USA) work requests.

**10 Confined Space Safety Equipment**

Replace the confined space safety equipment, including tripod, winch, rescue lines, portable ventilation units, rescue baskets and air bottles used for permit required confined space entry and rescue operations every five years.

**11 Portable CCTV Equipment**

Replace portable cctv equipment every ten years.

**12 Portable Sewer Rodder**

Replace potable sewer rodder every ten years.

**13 Portable Lighting Tower**

Replace the portable lighting tower used for emergency night time repairs every ten years.

**14 Sewer and Manhole Replacement Projects (CCTV)**

The maintenance department inspects manholes and wastewater lines to identify problem areas. Each year the wastewater lines and manholes that require replacement or rehabilitation are identified and prioritized by condition. The annual sewer replacement project is designed to address the highest priority areas until the budget limit is reached. The allocation of \$1,000,000 allows the replacement of approximately one mile of sewer main lines in the wastewater collection system.

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

<b>ITEM NO.</b>	<b>CAPITAL ITEM</b>
15	<b><u>Sewer and Manhole CCTV Projects</u></b> Conduct CCTV assessment of gravity sewer mains, interceptor line, and manholes throughout District.
16	<b><u>Carmel Gate Metering Station</u></b> Rehabilitate Carmel Gate flume metering station that meters all wastewater flow to CAWD treatment plant.
17	<b><u>Pump Station P-1 (CYPRESS GROVE) Est. 1969</u></b> Rehabilitate Sewer Pump Station P-1. Rehab scheduled for 2023.
18	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
19	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
20	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every ten years.
21	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
22	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
23	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.
24	<b><u>Pump Station P-2 (FANSHELL BEACH) Est. 1969</u></b> Rehabilitate Sewer Pump Station P-2. Rehab scheduled for 2023.
25	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
26	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
27	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every ten years.
28	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
29	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
30	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
31	<b><u>Pump Station P-3 (SEAL ROCK)</u></b> Est. 1990 Rehabilitate Sewer Pump Station P-3.
32	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
33	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
34	<b><u>Flow Meter</u></b> Replace Flow Meter every ten years.
35	<b><u>Wet Well Mixer (2)</u></b> Replace two Wet Well Mixers every ten years.
36	<b><u>Sump Pump Replacement</u></b> Replace duplex sump pumps every 10 years.
37	<b><u>Air Scrubber</u></b> Add description
38	<b><u>Pump Replacement (140hp)</u></b> Replace Sewer Pump Station Pumps every fifteen years.
39	<b><u>Solids Grinder (A)</u></b> Replace Solids Grinder every fifteen years, Grinder (A) scheduled for replacement in FY22/23.
40	<b><u>Solids Grinder (B)</u></b> Replace Solids Grinder every fifteen years, Grinder (B) scheduled for replacement in FY32/33.
41	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
42	<b><u>Surge Tank</u></b> Add description
43	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
44	<b><u>Emergency Power Generator</u></b> Replace Emergency Power Generator every fifteen years.
45	<b><u>Underground Diesel Storage Tank - TIUGA Conversion</u></b> Replace Underground Diesel Storage Tank every twenty-five years.
46	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
47	<b><u>Pump Station P-4 (HWY 68)</u></b> Est. 1969 Rehabilitate Sewer Pump Station P-4.
48	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
49	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
50	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every ten years.
51	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
52	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
53	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.
54	<b><u>Pump Station P-5 (SUNSET LN.)</u></b> Est. 1969 Rehabilitate Sewer Pump Station P-5.
55	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
56	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
57	<b><u>Flow Meter</u></b> Replace Flow Meter every ten years.
58	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every ten years.
59	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
60	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
61	<b><u>Emergency Power Generator</u></b> Replace Emergency Power Generator every fifteen years.
62	<b><u>Underground Diesel Storage Tank</u></b> Replace Underground Diesel Storage Tank every twenty-five years.

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
63	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.
64	<b><u>Pump Station P-6 (PESCADERO PT.) Est. 1969, rehab in 2015</u></b> Rehabilitate Sewer Pump Station P-6.
65	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
66	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
67	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every five years.
68	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
69	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
70	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.
71	<b><u>Pump Station P-7 (PBGL 18th) Est. 2012</u></b> Rehabilitate Sewer Pump Station P-7.
72	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
73	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
74	<b><u>Flow Meter</u></b> Replace Flow Meter every ten years.
75	<b><u>Wet Well Mixer</u></b> Replace one Wet Well Mixers every ten years.
76	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every ten years.
77	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
78	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
79	<b><u>Emergency Power Generator</u></b> Replace Emergency Power Generator every fifteen years.
80	<b><u>Underground Diesel Storage Tank - TIUGA Conversion</u></b> Replace Underground Diesel Storage Tank every twenty-five years.
81	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.
82	<b><u>Pump Station P-8 (SPANISH BAY) Est. 2007</u></b> Rehabilitate Sewer Pump Station P-8.
83	<b><u>Instrumentation</u></b> Replace Sewer Pump Station Instrumentation every five years.
84	<b><u>Remote SCADA Hardware and Software</u></b> Replace SCADA system Hardware for pump station every ten years.
85	<b><u>Wet Well Mixer</u></b> Replace one Wet Well Mixers every ten years.
86	<b><u>Pump Replacement</u></b> Replace Sewer Pump Station Pumps every ten years.
87	<b><u>Valves &amp; Appurtanances</u></b> Replace Sewer Pump Station Valves & Appurtanances every fifteen years.
88	<b><u>Control Panel</u></b> Replace Sewer Pump Station Control Panel every fifteen years.
89	<b><u>Force Main</u></b> Replace Sewer Pump Station Force-Main every twenty-five years.
90	<b><u>PB-1 Light Utility Truck (General)</u></b> The PB-1 utility truck will be replaced. This vehicle is a half-ton four-wheel drive pickup truck with an estimated useful life of ten years.
91	<b><u>PB-2 Line Cleaning/Vacuum Truck</u></b> Reserve Vac-Con Line/Vacuum truck is used to remove blockages, roots, and debris from the collection system using a water jetting system every ten years. It contains a water storage tank, a water pump, vacuum fan, debris storage tank and 800 feet of hose.
92	<b><u>PB-4 Heavy Utility Truck (Pump Station Crew)</u></b> This is a one-ton 4WD utility truck used primarily for pump station maintenance. The truck has an expected useful life of ten years.
93	<b><u>PB-5 Utility Truck (General)</u></b> This is a heavy-duty 4WD utility truck primarily used by the field operations manager every ten years.

**EXHIBIT C**  
**Wastewater Department Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
94	<b><u>PB-8 Line Cleaning Truck</u></b> Front-line equipment used on a daily basis to perform line cleaning activities to be replaced every ten years
95	<b><u>Sewer Line Cleaning Utility Vehicle (UTV)</u></b> Small utility vehicle with trailer jetter to be used for line cleaning when large line cleaning vehicles cannot access cleaning locations.
96	<b><u>PB-6 Dump Truck</u></b> This vehicle transports bulk material and allows the crew to perform more field construction work.
97	<b><u>Trailer Mounted Sewer Rodder</u></b> Replace the trailer-mounted continuous power rodder that is used to clear stoppages and perform routine root removal maintenance on wastewater lines and also provides a redundant capacity to clear sewer main lines if the line cleaning truck is out of service.
98	<b><u>10" Portable Pump</u></b> Replace the 10-inch, 3000-gpm portable wastewater pump, which allows the maintenance crew to bypass problem areas that require repair every fifteen years. The 10-inch diameter pump is sized to handle the expected wet weather flow for the 27-inch diameter interceptor line and to bypass pump station P3. This replacement will include a noise-reduction enclosure.
99	<b><u>6" Portable Pump</u></b> A trailer mounted 6-inch pump with sound-reducing enclosure capable of transporting wastewater will be purchased for smaller pump station bypass operations.
100	<b><u>G1 Portable Generator</u></b> Replace 60KW portable generator mounted on trailers with noise reduction enclosures every fifteen years to (used to serve Pump Station P-1)
101	<b><u>G2 Portable Generator</u></b> Replace 60KW portable generator mounted on trailers with noise reduction enclosures every fifteen years to (used to serve Pump Station P-2)
102	<b><u>G3 Portable Generator</u></b> Replace 60KW portable generator mounted on trailers with noise reduction enclosures every fifteen years to (used to serve Pump Station P-6)
103	<b><u>G4 Portable Generator</u></b> Replace 60KW portable generator mounted on trailers with noise reduction enclosures every fifteen years to (used to serve Pump Station P-4)
104	<b><u>PB-3 CCTV Camera Truck</u></b> Closed Circuit Television (CCTV) Camera Van to be purchased in FY 2025/26
105	<b><u>PB-7 Crane Truck</u></b> Flatbed truck and crane has a lifting capacity of 10,000 lbs.
106	<b><u>Backhoe Loader</u></b> This piece of equipment allows the maintenance crew to perform more field construction work and can be modified to act as a forklift.
107	<b><u>Easement Line Cleaning Equipment</u></b> This equipment extends the range of the line cleaning truck so that sewer lines located in areas with no vehicle accessibility can be reached without manually pulling hose.

\*\*Items are cost-shared with Recycled Water

**EXHIBIT D**  
**Carmel Area Wastewater District Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM	ROLL OVER	FISCAL YEAR COSTS (1,000)														
			26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41
PLANNED PROJECTS	1	Carmel River FREE Mitigation Project (Funded by Grants/County, See Below)*															
	2	Utility Mains Relocation Project (5.5% Collections)	\$236	\$63													
	3	Plant Bridge Retrofit Project	\$32	\$173	\$473	\$788	\$315										
	4	WWTP Site Improvements Project	\$206	\$584	\$584	\$289											
	5	Digester No. 1 - Rehabilitation			\$67	\$400											
	6	Replace Older Turblex Blower				\$17	\$177										
	7	Influent Pump Station Wet Well Repairs															
	8	Lagoon Crossing Rehabilitation															
	9	Ocean Outfall Maintenance															
	10	Outfall Cathodic Protection Anode Bed and Rectifier Replacement					\$50										
PROCESS AREA REHAB	11	Misc. Yard Piping Rehab and Maintenance Projects							\$30	\$30	\$30	\$30	\$30	\$30	\$30	\$30	\$30
	12	Influent/Headworks/Primary Rehab and Maintenance Projects							\$33	\$33	\$33	\$33	\$33	\$33	\$33	\$33	\$33
	13	EQ/Blowers/Aeration/Secondary Rehab and Maintenance Projects (Partial Reclamation)							\$57	\$57	\$57	\$57	\$57	\$57	\$57	\$57	\$57
	14	Chlorination/Dechlorination/Effluent Rehab and Maintenance Projects (Partial Reclamation)							\$28	\$28	\$28	\$28	\$28	\$28	\$28	\$28	\$28
	15	DAFT/Digestion/Dewatering Rehab and Maintenance Projects (Partial Reclamation)							\$28	\$28	\$28	\$28	\$28	\$28	\$28	\$28	\$28
16	CAWD Treatment Plant - CIP		\$175	\$75	\$50	\$50	\$30	\$30	\$30	\$30	\$30	\$30	\$30	\$30	\$30	\$30	\$30
TOTAL FISCAL YEAR COST (1,000)			\$649	\$896	\$1,174	\$1,543	\$572	\$207	\$207	\$207	\$207	\$207	\$207	\$207	\$207	\$207	\$207

CAWD TOTAL: \$6,904,000

**EXHIBIT E**  
**Undergrounding Overhead Utility Projects**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)															
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41	
1	Undergrounding Overhead Utility Projects	Annual	\$12,500	\$3,000	\$3,000	\$500	\$6,000	\$3,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	
TOTAL FISCAL YEAR COST (1,000)				\$3,000	\$3,000	\$500	\$6,000	\$3,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000	\$1,000

UNDERGROUNDING OVERHEAD UTILITY PROJECTS TOTAL PLAN COST      \$25,500,000



**EXHIBIT F**

**Recycled Water Distribution System Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM	USEFUL LIFE	ROLL OVER	FISCAL YEAR COSTS (1,000)															
				26/27	27/28	28/29	29/30	30/31	31/32	32/33	33/34	34/35	35/36	36/37	37/38	38/39	39/40	40/41	
37	Forest Lake Hypalon Liner	30 years													\$5,000				
38	Paved Assets	30 years																	
39	Well Pumps (4)	10 years			\$60											\$60			
40	4th Fairway Diversion Pumps (2) - 3hp	10 years		\$25											\$25				
<b>TOTAL FISCAL YEAR COST (1,000)</b>				\$115	\$355	\$440	\$495	\$100	\$200	\$245	\$60	\$1,515	\$315	\$5,120	\$80	\$340	\$315	\$75	

**TOTAL RECLAMATION DEPARTMENT PLAN COST**

**\$9,770,000**

\*\*Items are cost-shared with Wastewater Department

**EXHIBIT F**  
**Recycled Water Distribution System Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
1	<b><u>SCADA System Servers</u></b> ** (Replaced in 2020) Cost Share replacement of SCADA servers every five years, servers facilitates communication amongst reclamation facilities.
2	<b><u>SCADA System Software</u></b> ** (Upgraded in 2020) Cost Share Update SCADA System software every five years.
3	<b><u>SCADA System Remote Hardware</u></b> ** (Replaced in 2020) Update SCADA System hardware every ten years.
4	<b><u>Flow Meter Remote Measuring Systems (13)</u></b> Replace the irrigation meters and remote sensors on vault lids to allow recycled water meter readings to be electronically recorded without lifting the meter vault doors.
5	<b><u>Pipeline Cathodic Protection in Carmel</u></b> The recycled water transmission main throughout the City of Carmel is not protected against corrosion. A cathodic protection system is scheduled be designed and installed in FY2018/19 to reduce the potential for corrosion and extend the useful life of the pipeline.
6	<b><u>Cathodic Protection System - PBGL Maint. Yard</u></b> The recycled water transmission main from the Carmel gate passed the Pebble Beach Golf Links Maintenance Yard is protected against corrosion. The existing cathodic protection system should be rehabilitated in upcoming fiscal years to extend the useful life of the pipeline.
7	<b><u>Cathodic Protection System - Whitman Ln</u></b> The recycled water transmission main from the Pebble Beach Golf Links Maintenance Yard passed Whitman Lane is protected against corrosion. The existing cathodic protection system should be rehabilitated in upcoming fiscal years to extend the useful life of the pipeline.
8	<b><u>Cathodic Protection System - Forest Lake Rd</u></b> The recycled water transmission main from Whitman Lane to Forest Lake Road is protected against corrosion. The existing cathodic protection system should be rehabilitated in should be rehabilitated in upcoming fiscal years to extend the useful life of the pipeline.
9	<b><u>Cathodic Protection System - Forest Lake Reservoir</u></b> The recycled water transmission main from Forest Lake Road to Sloat Road is protected against corrosion. The existing cathodic protection system should be rehabilitated in FY 2032/33 reduce the potential for corrosion and extend the useful life of the pipeline.
10	<b><u>Pipeline Replacement</u></b> Cost not yet determined. Replacement of the cement mortar lined distribution main (approximately 7 miles of pipeline from CAWD to near Spanish Bay) every 50 years.
11	<b><u>Viscaino Generator (250kW)</u></b> Replace 250KW electrical generator at the Viscaino potable water pump station.
12	<b><u>Viscaino Pumps &amp; Motor Starters (2)</u></b> Replace the two potable water pumps and motor starters at the Viscaino pump station that supplies potable water to the 2.5 million-gallon storage tank.
13	<b><u>Viscaino Pump Controls</u></b> Replace the control system for the pumps at the Viscaino Pump Station
14	<b><u>Storage Tank Rehabilitation (Rehab. In 2020)</u></b> Rehabilitation of the 2.5 million-gallon recycled water storage tank including structural repairs, cathodic protection replacement, interior and exterior coating.
15	<b><u>Poppy Tank Mission Control</u></b> Mission unit at Poppy Hills Storage Tank to be replaced every ten years.
16	<b><u>Poppy Hills Generator with ATS</u></b> Poppy Hills Generator to be replaced every fifteen years with new automatic transfer switch.
17	<b><u>Air Diffuser Membrane Replacement</u></b> Replace a total of (60) flexible membrane tube diffusers located at the bottom of the Forest Lake Reservoir; used for aeration / vertical mixing.
18	<b><u>Forest Lake Strainer Replacement</u></b> Three strainers that remove algae material prior to distribution will be replaced.

**EXHIBIT F**  
**Recycled Water Distribution System Capital Outlay Plan**

ITEM NO.	CAPITAL ITEM
19	<b><u>Forest Lake Acid Injection Equipment</u></b> Acid injection equipment at Forest Lake Treatment Plant to be replaced every ten years.
20	<b><u>Forest Lake Chlorine Injection Equipment (2021)</u></b> Chlorine injection equipment at Forest Lake Treatment Plant to be replaced every ten years.
21	<b><u>Forest Lake Chemical Bldg. Instru. (Replaced in 2019)</u></b> The chlorine analyzer and pH meter for the Forest Lake facilities will be replaced every ten years.
22	<b><u>Forest Lake Feed Pumps (4)</u></b> Three feed pumps (one on VFD) and one spare pump that transport recycled water to the distribution system will be replaced every ten years.
23	<b><u>Forest Lake Feed Pump Motor Controllers (4)</u></b> Motor Controllers for Forest Lake Feed pumps to be replaced every ten years.
24	<b><u>Forest Lake Mixers (2)</u></b> Replace two horizontal mixers in Forest Lake every ten years.
25	<b><u>Forest Lake Multi-Probe (Replaced in 2019)</u></b> Replace multi-probe which measures, pH, BO, temperature, and chloroform at Forest Lake Reservoir every ten years.
26	<b><u>Forest Lake Inlet Flow Meter (Replaced in 2019)</u></b> Replace inlet flow meter used to measure quantity of recycled water entering Forest Lake every ten years.
27	<b><u>Forest Lake Outlet Structure Level System</u></b> Replace ultrasonic level indicator and high/low level sensors at Forest Lake Reservoir every ten years.
28	<b><u>Forest Lake Backwash Pumps (2)</u></b> Replace backwash basin pumps that return water from chemical building drain lines and strainer backwash to reservoir every ten years.
29	<b><u>Forest Lake Blowers (2)</u></b> Replace two blowers at Forest Lake Chemical Building that supply air and vertical mixing at Forest Lake every fifteen years.
30	<b><u>Forest Lake Generator (15kW)</u></b> Replace 15KW electrical generator used at Forest Lake Reservoir.
31	<b><u>Acid Tank Replacement (Replaced 2019)</u></b> Replace acid storage tank within the Forest Lake Chemical Storage Building every fifteen years
32	<b><u>Forest Lake Outlet Gate Electric Operators</u></b> Electric operators for Forest Lake Outlet Gates to be replaced at fifteen year intervals.
33	<b><u>Pontoon Work (Crane) Boat</u></b> Replace Pontoon work boat allows safe heavy lifting for servicing and repair of equipment (underwater mixers and underwater slide gates) located out in the Forest Lake Reservoir, replace every twenty years.
34	<b><u>3-Way Valve Box - Electronic Operator</u></b> Replace four electric gate operators on outlet structure every fifteen years
35	<b><u>Forest Lake Outlet Gates</u></b> Replace sluice gates and operators located at the outlet structure every twenty years.
36	<b><u>Forest Lake Air System Stainless Steel Piping</u></b> Replace the stainless steel air piping located at the bottom of Forest Lake every twenty years.
37	<b><u>Forest Lake Hypalon Liner</u></b> Replace the Hypalon Liner for Forest Lake every twenty years.
38	<b><u>Forest Lake Paved Assets</u></b> Replacement roadway pavement on Forest Lake site

**EXHIBIT F**  
**Recycled Water Distribution System Capital Outlay Plan**

<b>ITEM NO.</b>	<b>CAPITAL ITEM</b>
<b>39</b>	<b><u>Well Pumps</u></b> Well pumps for the three alternative source water project wells to be replaced every ten years.
<b>40</b>	<b><u>4th Fairway Diversion Pumps</u></b> 2 pumps at 3hp to be replaced every ten years.

\*\*Items are cost-shared with Wastewater Department